


MIN. 4" THICK RIGID INSULATION
LAYER WITH JOINTS STAGGERED
AND EXTENDING A MINIMUM OF 48"
EACH WAY FROM WATERMAIN
CENTERLINE



NOTES

1. ALL JOINTS WILL BE MECHANICALLY RESTRAINED USING TIE RODS OR WITH MEGA-LUG JOINT RESTRAINTS.

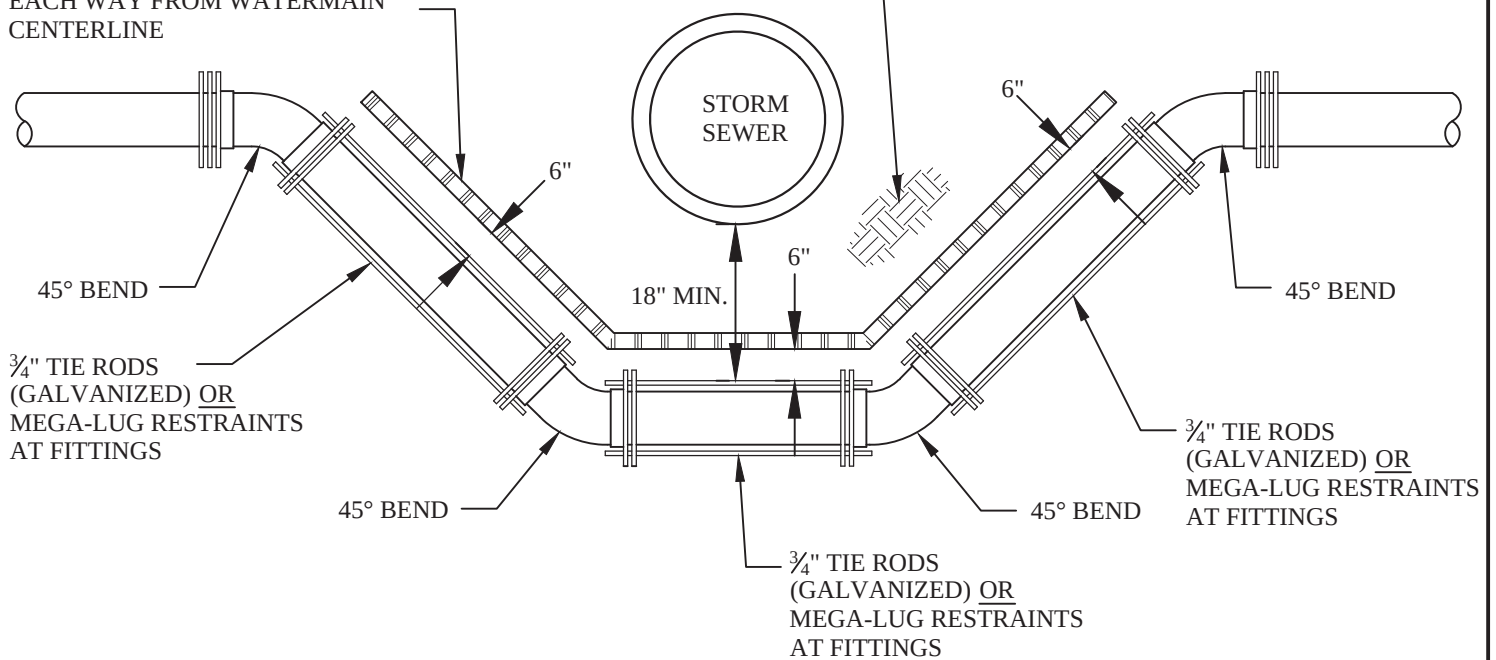

CITY OF BURNSVILLE - ENGINEERING DEPT. LOWER AND INSULATE WATERMAIN

Plate No.

WM-2

Revision Date

11/2013

File Location:

S:\Details\english\Watermain\WM02-LowerInsulate.dwg