




**NOTES:**

1. THE PIPE WILL BE BEDDED IN COMPACTED GRANULAR MATERIAL PLACED ON A FLAT TRENCH BOTTOM. THE GRANULAR BEDDING WILL HAVE A MINIMUM THICKNESS OF  $\frac{1}{4}$  THE OUTSIDE DIAMETER (3" MIN.) AND WILL EXTEND UP TO THE SPRINGLINE.
2. THE TRENCH WILL BE FILLED WITH CAREFULLY COMPACTED BACKFILL TO A MIN. DEPTH OF 12" OVER THE TOP OF THE PIPE.

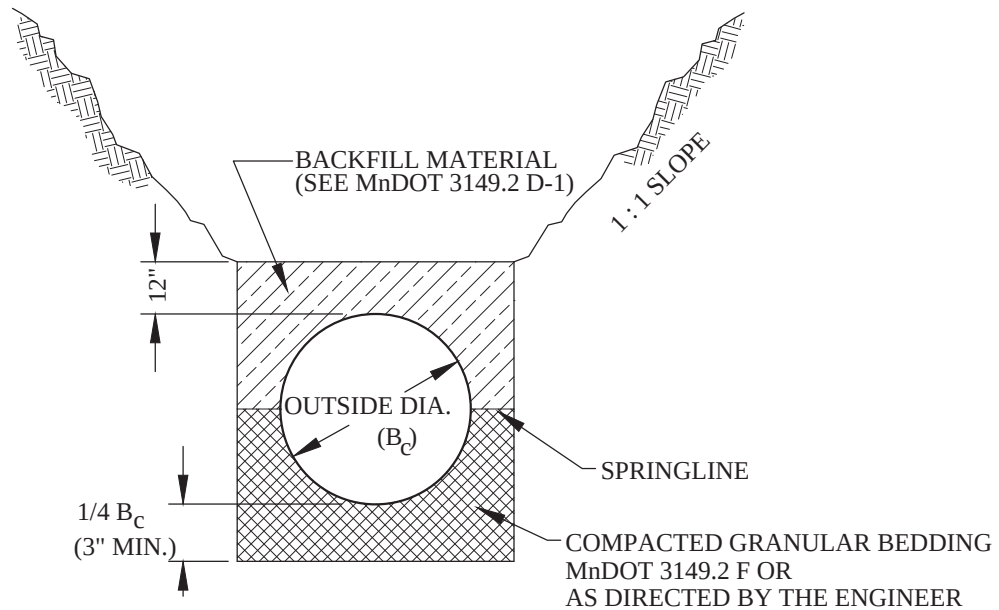

CITY OF BURNSVILLE - ENGINEERING DEPT.  
**PVC & HDPE PIPE BEDDING**

Plate No.

**PB-4**

Revision Date

**1/2018**

File Location:

S:\Details\english\Pipe Bedding\PB04-PVC HDPE Bedding.dwg