



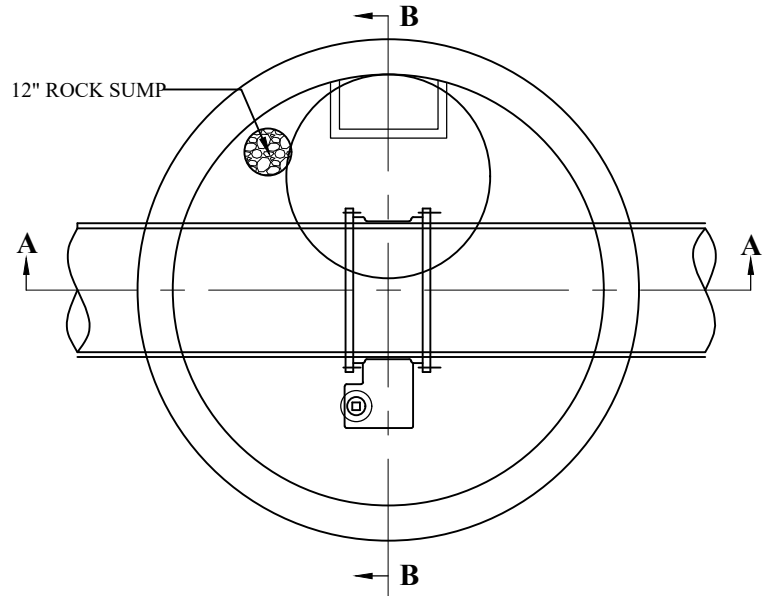

NOTES

1. "KOR-N-SEAL" OR APPROVED EQUIVALENT PRE-CAST GASKETED BOOT CONNECTION WILL BE USED FOR CONNECTING PIPE TO MANHOLE.
2. MANHOLE COVERS WILL BE CAST WITH THE WORDS "WATER".
3. INDIVIDUAL ADJUSTMENT RINGS MAY BE CONCRETE OR HDPE (CHIMNEY SEAL SUBSTITUTES CONCRETE COLLAR WITH HDPE RINGS).

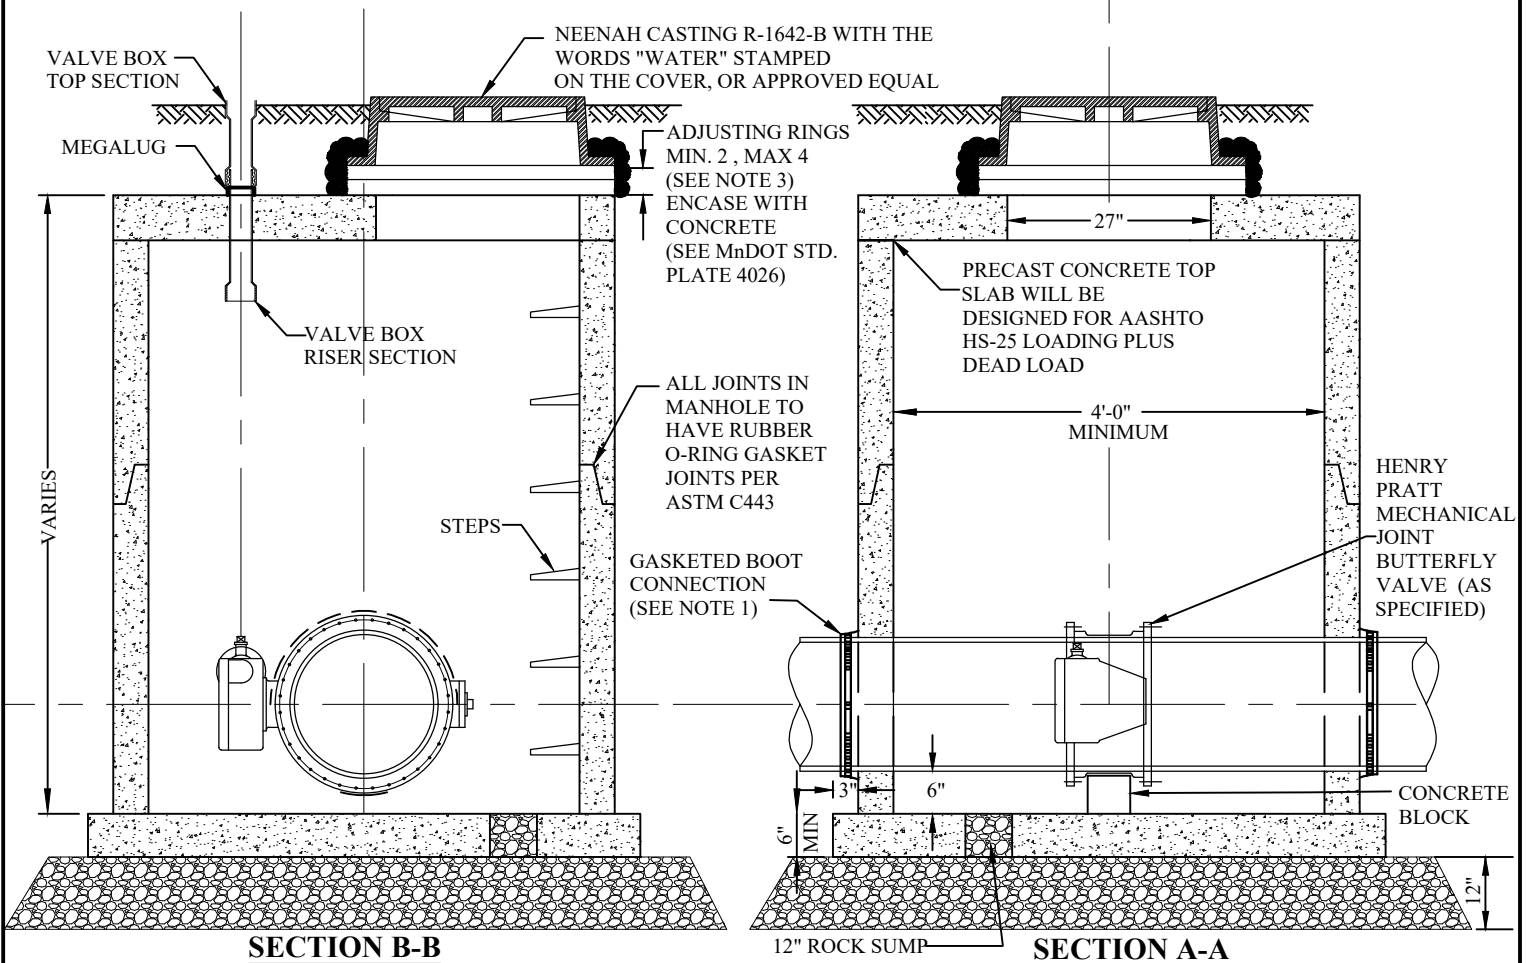

CITY OF BURNSVILLE - ENGINEERING DEPT.
BUTTERFLY VALVE MANHOLE
12" -24" PIPES SIZES

Plate No.

WM-11

Revision Date

12/2023

File Location:

S:\Details\english\Watermain\WM11-Butterfly_Valve_MH_small.dwg