


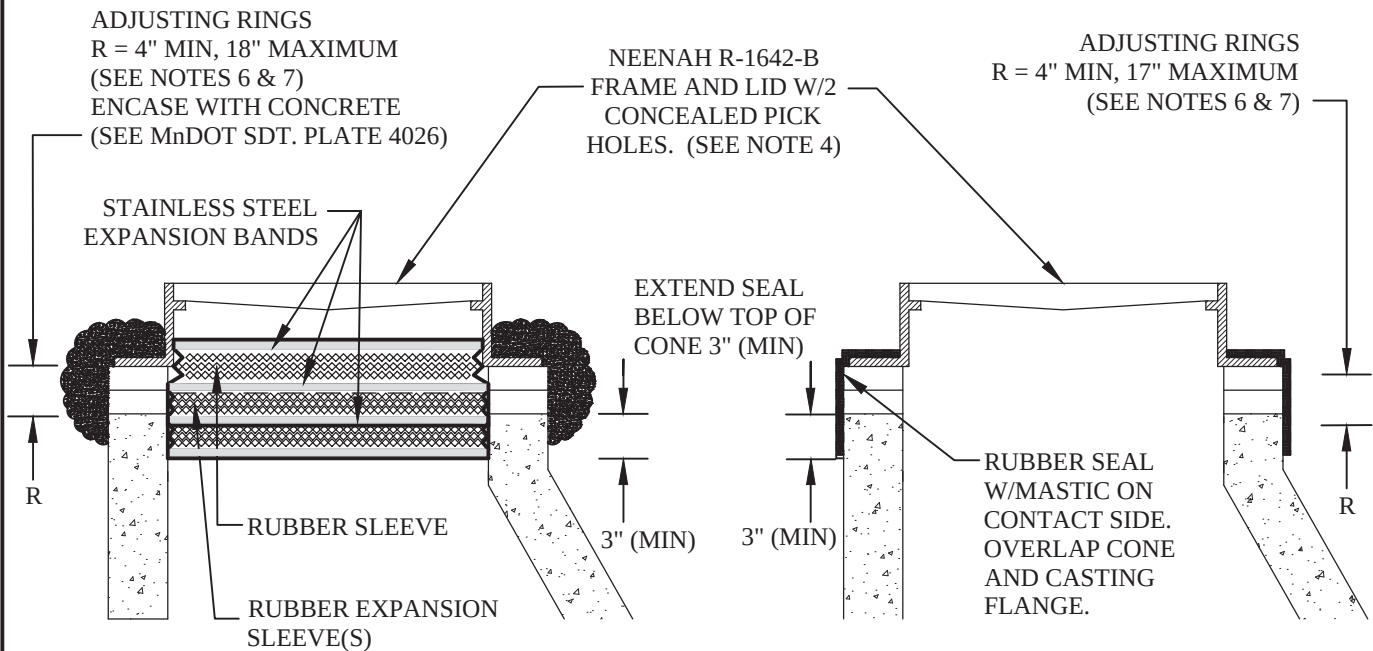

INTERNAL CHIMNEY SEAL

EXTERNAL CHIMNEY SEAL

NOTES

1. THE CONTRACTOR MAY USE EITHER INTERIOR OR EXTERIOR CHIMNEY SEALS.
2. CHIMNEY SEALS WILL BE INSTALLED AT ALL SANITARY SEWER MANHOLES LOCATED AT OR NEAR A LOW-POINT IN THE STREET GRADE, AND WHERE OTHERWISE INDICATED IN THE PLANS.
3. CHIMNEY SEALS AND CHIMNEY SEAL EXTENSIONS WILL BE INSTALLED TO COMPLETELY SPAN THE CHIMNEY HEIGHT OF THE MANHOLE.
4. CHIMNEY SEALS WILL BE INSTALLED AFTER THE CASTING IS RAISED TO FINISHED GRADE.
5. INSTALL CHIMNEY SEALS IN ACCORDANCE WITH THE MANUFACTURER RECOMMENDATIONS.
6. INDIVIDUAL ADJUSTMENT RINGS MAY BE CONCRETE OR HDPE, AND MAY RANGE IN THICKNESS FROM 1.5" TO 4".
7. WHERE APPLICABLE, "EXTRA DEPTH" CASTING ADJUSTMENT MAY INCREASE DEPTH OF RINGS TO 36" (3.0').



CITY OF BURNSVILLE - ENGINEERING DEPT.

CHIMNEY SEALS INTERNAL & EXTERNAL

Plate No.

SS-6

Revision Date

11/2013

File Location:

S:\Details\english\Sanitary Sewer\SS06-Chimney Seal.dwg